

ARCHIVED



Department of
Building and Housing
Te Tari Kaupapa Whare

Amendment 7, effective 4 April 2011, to the Compliance Document for Clause B2 Durability of the New Zealand Building Code.

| Section | Old B2 | April 2011 Erratum to B2 |
|----------------|--|--|
| Title pages | Remove title page and document history | Replace with new title page and document history |
| Contents | Remove pages 5–6 | Replace with new pages 5–6 |
| References | Remove pages 7–8 | Replace with new pages 7–8 |
| B2/AS1 | Remove pages 15–16 | Replace with new pages 15, 15A–15F, 16 |

Compliance Document for New Zealand Building Code Clause B2 Durability

Prepared by the Department of Building and Housing

This Compliance Document is prepared by the Department of Building and Housing. The Department of Building and Housing is a Government Department established under the State Sector Act 1988.

Enquiries about the content of this document should be directed to:



Department of
Building and Housing
Te Tari Kaupapa Whare

Department of Building and Housing
PO Box 10-729, Wellington.
Telephone 0800 242 243
Fax 04 494 0290
Email: info@dbh.govt.nz

Compliance Documents are available from www.dbh.govt.nz

New Zealand Government

© Department of Building and Housing 2011

This Compliance Document is protected by Crown copyright, unless indicated otherwise. The Department of Building and Housing administers the copyright in this document. You may use and reproduce this document for your personal use or for the purposes of your business provided you reproduce the document accurately and not in an inappropriate or misleading context. You may not distribute this document to others or reproduce it for sale or profit.

The Department of Building and Housing owns or has licences to use all images and trademarks in this document. You must not use or reproduce images and trademarks featured in this document for any purpose (except as part of an accurate reproduction of this document) unless you first obtain the written permission of the Department of Building and Housing.

Status of Compliance Documents

Compliance Documents are prepared by the Department of Building and Housing in accordance with section 22 of the Building Act 2004. A Compliance Document is for use in establishing compliance with the New Zealand Building Code.

A person who complies with a Compliance Document will be treated as having complied with the provisions of the Building Code to which the Compliance Document relates. However, a Compliance Document is only one method of complying with the Building Code. There may be alternative ways to comply.

Users should make themselves familiar with the preface to the New Zealand Building Code Handbook, which describes the status of Compliance Documents and explains alternative methods of achieving compliance.

Defined words (italicised in the text) and classified uses are explained in Clauses A1 and A2 of the Building Code and in the Definitions at the start of this Compliance Document.

| B2: Document History | | | |
|--|--|--|---|
| | Date | Alterations | |
| First published | July 1992 | | |
| Amendment 1 | September 1993 | p. 3, Table 1 | |
| Second Edition | 28 February 1998 | Document revised – second edition issued | |
| Amendment 2 | 1 December 2000 | p. ii, Document History p. v, Contents p. vi, References | p. 5, 3.2.2, 3.3, 3.4 p. 9, Index |
| Amendment 3 | 1 July 2001 | p. 2, Document History, Status p. 7, References | p. 8, 5.0.1 |
| Amendment 4 | 1 April 2004 | p. 2, Document History p. 7, References pp. 9–10, Definitions | p. 15, 3.2.1 Comment pp. 17–22 Table 1 p. 23 Index |
| Amendment 5 | 1 April 2004 | p. 7, References p. 9, Definitions | p. 15, 3.2.1, 3.2.2, 3.2.3 |
| Amendment 5 regarding timber treatment is subject to a transitional provision. | | | |
| Reprinted incorporating Amendments 3, 4 and 5 | April 2004 | | |
| Amendment 6 | Published 30 June 2010 Effective from 30 September 2010 | p. 2, Document History, Status p. 5, Contents p. 7, References | pp. 9–10, Definitions pp. 13–15, B2/AS1 1.1, 3.1.1, 3.2.1, 3.2.2 |
| Reprinted incorporating Amendment 6 | Published 30 June 2010 Effective 30 September 2010 | | |
| Amendment 7 | Effective 4 April 2011 Supersedes Amendment 6 version 30 July 2011 | p. 2, Document History, Status p. 5, Contents | p. 7, References pp. 15–15F, 3.2.1, 3.2.2, 3.2.3 |
| Notes: | | | |
| <ul style="list-style-type: none"> • B2/AS1 Amendment 7 version is effective from 4 April 2011. • Up to 30 June 2011, B2/AS1 Amendment 6 version may also be used. • From 1 July 2011, only B2/AS1 Amendment 7 version applies, and supersedes all previous versions of the document. | | | |
| Note: Page numbers relate to the document at the time of Amendment and may not match page numbers in current document. | | | |

Document Status

The most recent version of this document, as detailed in the Document History, is approved by the Chief Executive of the Department of Building and Housing.

People using this Compliance Document should check for amendments on a regular basis. The Department of Building and Housing may amend any part of any Compliance Document at any time. Up-to-date versions of Compliance Documents are available from www.dbh.govt.nz

Contents

| | Page |
|---|-------------|
| References | 7 |
| Definitions | 9 |
| Verification Method B2/VM1 | 11 |
| 1.0 Durability Evaluation | 11 |
| 1.1 In-service history | 11 |
| 1.2 Laboratory testing | 11 |
| 1.3 Similar materials | 11 |
| Acceptable Solution B2/AS1 | 13 |
| 1.0 Durability Applications | 13 |
| 1.1 Compliance Documents | 13 |
| 1.2 Assessing required durability | 13 |
| 1.3 Examples of durability requirements | 14 |
| 2.0 Maintenance | 14 |
| 2.1 Normal maintenance | 14 |
| 2.2 Scheduled maintenance | 14 |
| 3.0 Generic Materials | 14 |
| 3.1 Concrete | 14 |
| 3.2 Timber | 15 |
| 3.3 Solid plastering | 15F |
| 3.4 Earth buildings | 15F |
| Index | 23 |

Amend 6
Sep 2010

Amend 7
Apr 2011
Amend 2
Dec 2000

ARCHIVED

References

For the purposes of New Zealand Building Code (NZBC) compliance, the Standards and documents referenced in this Verification Method and Acceptable Solution (primary reference documents) must be the editions, along with their specific amendments, listed below. Where these primary reference documents refer to other Standards or documents (secondary reference documents), which in turn may also refer to other Standards or documents, and so on (lower-order reference documents), then the version in effect at the date of publication of this Verification Method and Acceptable Solution must be used.

Amend 7
Apr 2011Amend 6
Sep 2010

Standards New Zealand

NZS 3101:- Concrete structures standard
Part 1: 2006 The design of concrete structures
Amend: 1, 2

Amend 7
Apr 2011Amend 5
Apr 2004

NZS 3602:-
Part 1: 2003 Timber and wood-based products for use in building

Amend 3
Jul 2001Amend 2
Dec 2000

NZS 3604: 1999 Timber framed buildings
Amend: 1

Amend 7
Apr 2011

NZS 3640: 2003 Chemical Preservation of round and sawn timber
Amend: 1, 2, 3 and 4

Amend 6
Sep 2010

NZS 4251:- Solid plastering
Part 1: 2007 Cement plaster for walls, ceilings and soffits

NZS 4297: 1998 Engineering design for earth buildings

Amend 2
Dec 2000

NZS 4299: 1998 Earth buildings not requiring specific design
Amend: 1

Where Quoted

AS1 3.1.1

AS1 3.2.1, 3.2.2

Amend 5
Apr 2004

AS1 3.2.3

Amend 5
Apr 2004

AS1 3.2.1, 3.2.3

AS1 3.3.1

AS1 3.4.1

AS1 3.4.1

ARCHIVED

or unquantified terms include, but are not limited to, special studies, manufacturer's advice and references to methods that are appropriate, adequate, suitable, relevant, satisfactory, acceptable, applicable, or the like. Such provisions must be treated as the basis of an alternative solution proposal.

Amend 6
Sep 2010

3.2 Timber

3.2.1 The following Standards form an *Acceptable Solution* for B2/AS1 meeting the durability requirements of timber *building elements*,

- a) Part 1 of NZS 3602 for listed species, excluding radiata pine and Douglas fir solid timber
- b) NZS 3640 and Part 1 of NZS 3602 for radiata pine and Douglas fir solid timber, with the amendments set out in Paragraphs 3.2.2 and 3.2.3
- c) NZS 3604, with reference to NZS 3602 (and NZS 3640) as amended in Paragraph 3.2.1 b).

COMMENT:

The use of different timbers or timber treatments to those referred to in NZS 3602 are outside the scope of this *Acceptable Solution*. Where the use of a different timber or timber treatment is proposed, it shall be separately assessed for compliance with the *Building Code*. For example, if imported hard-wood is to be used to surface a deck, evidence that the timber was *durable* for a minimum of 15 years in the expected exposure conditions is required.

3.2.2 Amendments to NZS 3602 for Paragraph 3.2.1 b) above.

3.2.2.1 Level of treatment references to radiata pine and Douglas fir solid timber in Table 1 categories 'C', 'D' and 'E' and Table 2 category 'B' shall be replaced by Tables 1A and 2A below. Table 1A and Table 2A are to be read with NZS 3602 sections 108 to 111 inclusive, with the amendments in Paragraph 3.2.2.3 below.

Other references to radiata pine and Douglas fir solid timber in NZS 3602, including Table 1 categories 'A', & 'B'; Table 2 category 'A'; and Table 3 are unaltered.

Amend 7
Apr 2011

Table 1A Requirements for radiata pine and Douglas fir solid timber to achieve a (minimum) 50 year durability performance

| Ref No. | Wood-based building components | Species or type | Level of treatment ⁽²⁾ to NZS 3640 |
|--|---|---|---|
| C – Members protected from the weather but exposed to ground atmosphere (see section 108 of NZS 3602) | | | |
| 1C.1 | Jackstuds, subfloor braces, bearers, wall plates, floor joists to the subfloor, blocking, subfloor wall studs, wallings and battens, wall studs and nogs, diagonal boards | Radiata pine Douglas fir | H1.2 |
| 1C.3 | Interior flooring, suspended ground floors | Radiata pine Douglas fir | H1.2 |
| NOTE | | | |
| (2) Throughout Table 1A, timber treated to a higher level than the minimum satisfies the minimum requirements | | | |
| D – Members protected from the weather but with a risk of moisture penetration conducive to decay (see section 109 of NZS 3602) | | | |
| Roof members (in or associated with) | | | |
| 1D.1 | Sarking and framing not protected from solar driven moisture through absorbent cladding materials ⁽⁸⁾ | Radiata pine Douglas fir | H1.2 |
| 1D.2 | Enclosed flat roof framing and associated roof members | Radiata pine Douglas fir | H1.2 |
| 1D.3 | Enclosed skillion roof framing and associated roof members | Radiata pine Douglas fir | H1.2 |
| 1D.4 | Valley boards and boards supporting flashings or box gutters and flashings to roof penetrations and upstands to roof decks ⁽¹⁰⁾ | Radiata pine Douglas fir | H1.2 |
| Wall members (in or associated with) | | | |
| 1D.5 | Framing and other members within or beneath a parapet | Radiata pine Douglas fir | H1.2 |
| 1D.6 | Framing, and other members within enclosed decks or balconies | Radiata pine Douglas fir | H1.2 |
| 1D.7 | Cantilevered enclosed deck joists and associated framing including joist trimmers, nogs, and blocking ⁽⁵⁾ | Radiata pine Douglas fir | H3.2 |
| 1D.8 | Framing and other members supporting enclosed decks (including enclosed cantilevered decks) or balconies | Radiata pine Douglas fir | H1.2 |
| 1D.10 | Battens used behind cladding to form a cavity | Radiata pine Douglas fir | H3.1 |
| 1D.14 | All other exterior wall framing and other members including exterior and boundary joist ⁽⁹⁾ ⁽¹¹⁾ | Radiata pine Douglas fir ⁽¹⁴⁾ | H1.2 |

NOTE

(5) H3.2 refers to preservative treatments outlined in NZS 3640.

(8) Timber shakes and shingles, and similar absorbent claddings, absorb moisture that can be driven in frame cavities by evaporation. Unless the cavities are adequately drained and ventilate, continuing condensation caused by solar driven transfer increases the moisture content in the cavities and timber framing requiring a higher level of timber treatment to resist decay.

(9) Such as joists, lintels, wall plate and double top plates, studs, together with parapets, enclosed balustrades, boxed columns and chimneys

(10) Any metal flashing shall be separated from the treated timber with building paper.


(11) Exposed ends of joists shall be protected by a boundary joist.

Amend 7
Apr 2011

| Table 1A | | Requirements for radiata pine and Douglas fir solid timber to achieve a (minimum) 50 year durability performance | |
|---|--|---|--|
| Ref No. | Wood-based building components | Species or type | Level of treatment ⁽²⁾ to NZS 3640 |
| E – Members not exposed to weather or ground atmosphere and in dry conditions (see section 110 of NZS 3602) | | | |
| 1E.1 | All roof trusses, including gable end trusses, roof framing, ceiling and eaves framing, purlins and battens | Radiata pine Douglas fir ⁽¹⁴⁾ | H1.2 |
| 1E.2 | All midfloor framing including boundary joists, ceiling framing, ceiling battens, and double top plates | Radiata pine Douglas fir ⁽¹⁴⁾ | H1.2 |
| 1E.3 | Wall framing and roof framing (including trusses) protected from the weather, in unlined and unoccupied farm buildings and outbuildings except those not allowed in 110.2(f) of NZS 3602 | Radiata pine Douglas fir | None |
| 1E.5 | Internal walls | Radiata pine Douglas fir ⁽¹⁴⁾ | H1.2 |
| 1E.7 | Interior flooring | Pinus species Douglas fir ⁽¹⁴⁾ | H1.2 |
| NOTE (14) Exceptions to the levels of treatment for Douglas fir are provided in Paragraph 3.2.2.2 of this <i>Acceptable Solution B2/AS1</i> . | | | |

| Table 2A | | Requirements for radiata pine and Douglas fir solid timber to achieve a 15-year durability performance | |
|---|--|---|---|
| Ref No. | Wood-based building components | Species or type | Level of treatment⁽²⁾ |
| B – Members protected from the weather and dampness (see section 111 of NZS 3602) | | | |
| 2B.1 | Non-load bearing interior wall framing | Radiata pine Douglas fir ⁽⁹⁾ | H1.2 |
| 2B.2 | Stair treads, risers and handrails | Radiata pine Douglas fir ⁽⁹⁾ | None |
| NOTE (2) Throughout Table 2A, timber treated to a higher level than the minimum satisfies the minimum requirements (9) Exceptions to the levels of treatment for Douglas fir are provided in Paragraph 3.2.2.2 of this <i>Acceptable Solution B2/AS1</i> . | | | |

Amend 7
Apr 2011

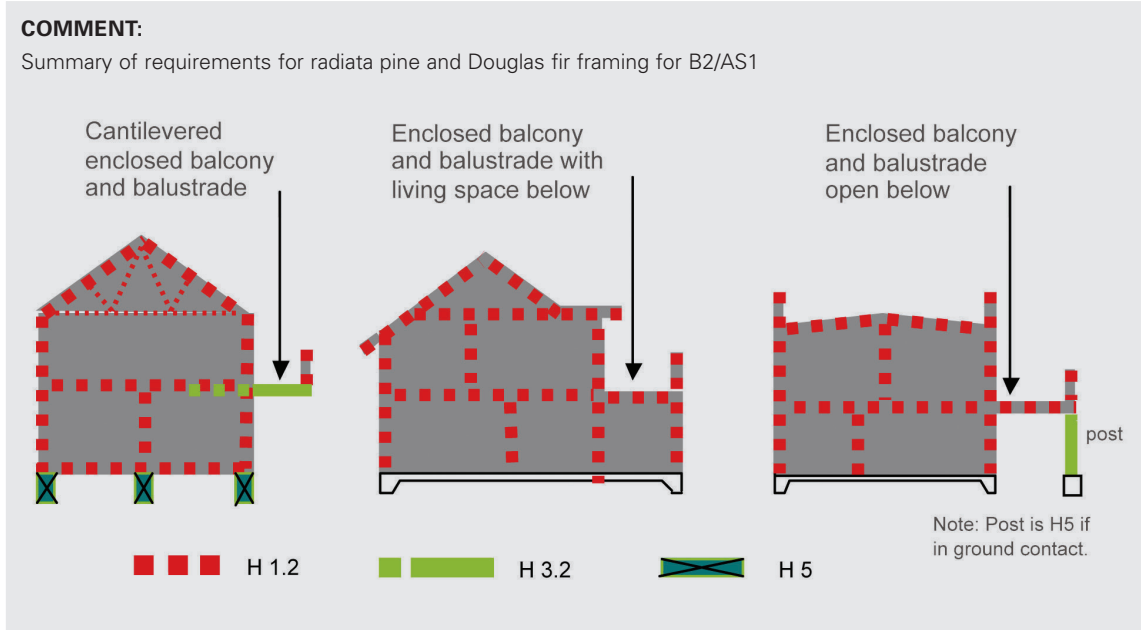

3.2.2.2 Exceptions for the use of untreated Douglas fir

Preservative-free (untreated) solid Douglas fir framing may be used for roof members protected from the weather, floor members protected from the weather and not exposed to ground atmosphere, and for internal and external wall framing protected from the weather provided that the *building* meets all of the following requirements:

- a) is a stand alone, single household unit of no more than two storeys (as defined in NZS 3604) and designed and constructed to NZS 3604, and
- b) is situated in wind zones no greater than High as defined in NZS 3604, and
- c) has an envelope complexity of no greater than medium risk and a deck design no greater than low risk as defined by the risk matrix in E2/AS1, and
- d) has drained and vented cavities complying with E2/AS1 behind all claddings, and
- e) uses roof and wall cladding systems and details conforming with Acceptable Solution E2/AS1, and

- f) has a risk matrix score of no more than 6 on any external wall face as defined in E2/AS1, and
- g) has a simple pitched roof incorporating hips, valleys, gables, or mono pitches, all draining directly to external gutters; but excluding internal or secret gutters, concealed gutters behind fascias, or any roof element finishing within the boundaries formed by exterior walls (eg, the lower ends of aprons, chimneys, dormers, clerestories, box windows, etc), and
- h) has a roof slope of not less than 10°, and
- i) if it has a skillion roof, then the roofing material shall be corrugated iron or concrete, metal or clay tiles to ensure adequate ventilation, and
- j) has eaves 450 mm wide or greater for single storey houses, and eaves 600 mm or greater for two storey houses.

COMMENT:
 This Paragraph 3.2.2.2 provides an option for those who do not want to use chemically treated timber in their home. In the case of commercial or other building categories, the use of untreated Douglas fir to comply with the *Building Code* is outside the scope of this *Acceptable Solution* and needs to be considered on a case-by-case basis.

3.2.2.3 Amendments to NZS 3602 sections 109, and 110

Table 1A and Table 2A are to be read with NZS 3602 sections 109 and 110 including amendments below.

- 109.2 (a) (iii) Delete and replace with:
Members supporting enclosed cantilevered decks having increased risk of failure due to there being single points of support.
- 109.2 (b) Delete and replace with:
Timber framed elements exposed to exterior weather conditions on both faces such as parapets and balustrades, or exterior boxed beams columns or chimneys.
- 109 (c) (vi) Delete
- 109 (c) (vii) Delete and replace with:
Framing and other members in exterior walls including boundary joists.
- Figure 1 Delete
- Figure 2 Delete
- Figure 3 Delete
- 110.2 (b) Delete
- 110.2 (c) Delete and replace with:
Internal walls
- 110.3.1 Delete and replace with:
Floor coverings in 'wet areas' such as laundries, bathrooms, kitchens and toilets shall be as set out in E3/AS1. Where maintenance of an impervious coating cannot be assured in wet areas, plywood flooring treated to minimum H3, or solid pinus species or Douglas fir flooring treated to minimum H1.2, shall be used.

COMMENT:

For Paragraph 3.2.1 a) above, sections 109 and 110 of NZS 3602 remain unaltered.

Amend 7
Apr 2011

3.2.3 Amendments to NZS 3640 for 3.2.1 b) above.

3.2.3.1 The following treatments listed in NZS 3640 shall not be used as framing preservative: Bis-(tri-n-butyltin) oxide (TBTO), Bis-(tri-n-butyltin) naphthenate (TBTN), and Iodo propynyl butyl carbamate (IPBC).

3.2.3.2 Table 4.4 – remove H1.2 from the hazard classes column in the Copper naphthenate (CuN) line.

COMMENT:

Including H1.2 hazard class for CuN is inconsistent with H1.2 preservatives listed in Table 6.1.

3.2.3.2 Table 5.2 – Colour coding for timber to be used as framing shall be replaced with the following Table:

| Hazard class | Preservative | Colour ⁽¹⁾ |
|--------------|--|--|
| H1.2 | Boron | Pink ⁽²⁾ |
| H3.1 | Propiconazole + tebuconazole/permetherin | No added colour ⁽³⁾ or green ⁽⁴⁾ |

Note –

(1) These colours shall not be used for any preservative types/hazard classes other than specified.

(2) Colour – Red 112 (red) or Red 122 (pink).

(3) H3.1 framing shall be branded repetitively along the length at 1500 mm centres maximum on its face or edge.

(4) If coloured green, the colour is to be distinctly different (Colour Green 368) from the green of the H3.2 preservative treatment – see C Table 5.2 (a) below.

3.2.3.3 Table 6.1 – Minimum preservative retention in the H1.1, H1.2 analysis zone (sawn timber), shall be replaced with the following table:

| Preservative type | Component | Retention %m/m oven Dry weight of wood |
|--------------------------|--------------------------------|--|
| | | H1.2 |
| Waterborne preservatives | | |
| Boron compounds – | | |
| Softwoods x-sect | H ₃ BO ₃ | 0.40 ⁽¹⁾ |

Note:

(1) This cross-section retention is required whether the material is sampled wet, where the timber is intended to be air dried, or on the dry timber

3.2.3.4 Note (1) of Table 6.2 shall be deleted and replaced with the following:

(1) Boron compounds are approved for H3.1 only for timber boards for fascia, cladding, joinery, cavity battens and other timber components less than 30 mm thick and only when an oil alkyd, modified acrylic or modified latex grey pigmented coating is applied to all timber surfaces, after treatment and before dispatch from the treatment plant.

Amend 7
Apr 2011

3.3 Solid plastering

3.3.1 NZS 4251: Part 1 is an acceptable solution for meeting the durability requirements of cement plasters for walls, ceilings and soffits within its scope.

3.4 Earth buildings

3.4.1 NZS 4297 and NZS 4299 are acceptable solutions for meeting the durability requirements of earth *buildings* within their scope.

Amend 2
Dec 2000

Figure 1: Assessment of Durability Requirement
Paragraph 1.2.2

